

MEMO TO FILE


On Friday, February 24, 1995, at 3:00 p.m. Julie received a call from the dispatcher at City Utilities about pollution in a gas valve box at 1900 E. Meadowmere. Julie sent 551 (Omer Boyce and Roy Robberson) to that location to check the line. She also suggested that CU call the fire department. I got there about 3:30 p.m. Gary Corson from City Utilities was there. The valve is located near the corner of Plaster's Garage at 1945 E. Cozy. He said he was checking the gas valve box with his GCI and it went up to 10% L.E.L. and then wouldn't work. He said the personnel from the Fire Department checked the gas valve box also and got 50% L.E.L. with their multi-gas meter, but couldn't tell what kind of gas it was. They checked the manhole near the guard house in front of Kraft (MH 2, Wye Map S-14) and got 0% L.E.L. The fire department then checked the manhole in the alley nearest the gas valve (MH 3, Wye Map S-14) and got 5% L.E.L. I checked MH 2 and got 0% L.E.L. and MH 3 and got a 0-1% on the explosion meter. Omer and I opened the cover for manhole 3 to see if we could smell any kind of gas, but all we could smell was the dairy odor from Kraft. I checked the manhole near the front of Plaster's Garage (MH 8, Wye Map S-14) and got 0% L.E.L., then went to the next one to the west of this (MH 46, Wye Map S-13) and got a reading of 0% L.E.L. About 4:15 p.m. I checked MH 3 and got 0-1% L.E.L. again, I checked the manhole to the south of this (MH 4, Wye Map S-14) and got 1-2% L.E.L. I checked manhole 5 (Wye Map S-14) and got a reading of 0-1% L.E.L. and manhole 6 (Wye Map S-14) and got a reading of 0% L.E.L. Gary Corson said they would grease the valve to eliminate anything that might be leaking from them. On my way back to the office, Randy called and I told him what I found out.

On Monday, February 27, Gene and I checked manholes 3 and 4 again. The reading at MH 3 was 0% L.E.L. and at MH 4 it was 0-1%, but there was a lot of steam.

*Karen Chandler*

Karen Chandler  
WPCI II  
SS, E & B  
CUGV0295.WPD

1900 E. MEADOWMERE

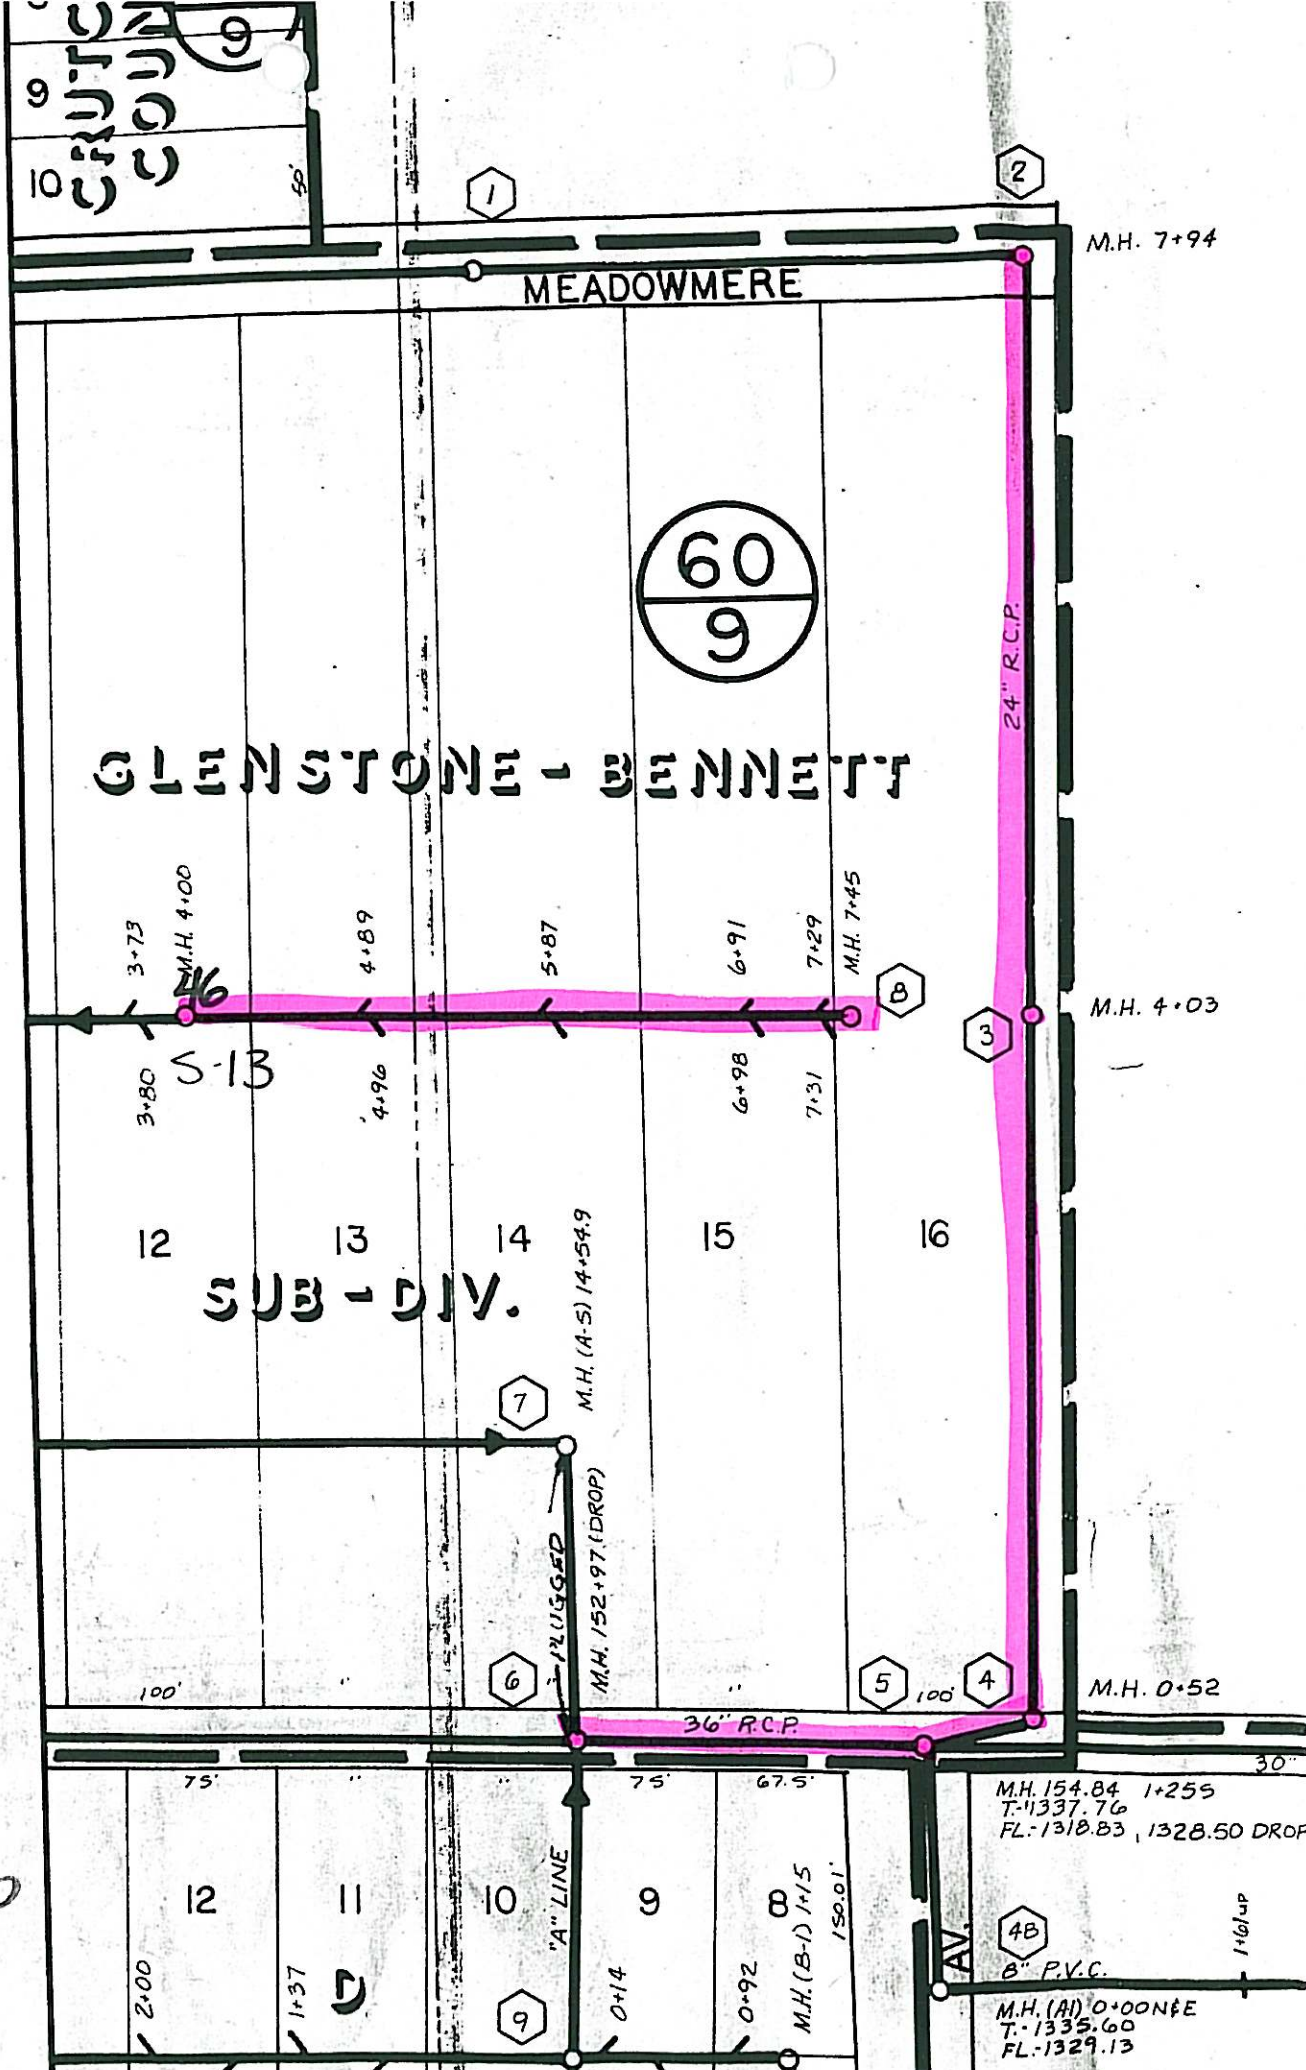

WYE MAP  
S-14

Karen + Eric  
FPI  
R.

## **TELEPHONE LOG SHEET**

**INDUSTRY NAME:** CITY UTILITIES

**DATE:** MARCH 1, 1995

**CONTACT PERSON:** GARRY CORSON

**TIME:** 9:20 a.m.

**NUMBER CALLED:** 8751

### **PURPOSE OF CALL**

Gary called to inform us that they believe they have a gas leak on Meadowmere on the high pressure line serving Kraft. Because of all the asphalt in the area, he indicated that a leak on high pressure is difficult to pinpoint. He has checked manholes in the area and has not gotten high readings. Would like for us to check our sewer periodically as a precaution. They hope to locate and repair the leak within 15 days.

**SIGNATURE**

*Randy Lyman*